

INDOOR AIR HYGIENE GROUP

Ref.-No.: KKL/1072/20 Essen, 1 December 2020
Order-No.: 81 18 52 83 25 GrV/DoKI

**TÜV NORD Systems
GmbH & Co. KG**
ISGBW Testing

Am TÜV 1
45307 Essen, Germany
+49 201 825 - 3204
GBTesting@tuev-nord.de
www.tuev-nord.de
TÜV®

Report No.: TR-KKL-2020-102

**Test on a Pleated Combi Filter Element
based on DIN 71460-1**

Client	Stadler Form AG Chamerstr. 174 6300 Zug Switzerland
Testing object	Pleated Combi Filter Element "Roger Dual Filter H12" Serial-No.: ---
Order	PO 4082
Date of order	30.09.2020
Arrival of the testing objects	06.10.2020
Content of order	Determination of the initial fractional efficiency according to Section 8.2 of DIN 71460-1
Standard of test	DIN 71460-1:2006
Test period	November 2020

The test report consists of 6 pages.

The test results refer exclusively to the test objects.
It is not permitted to publish extracts from the report without the written permission of TÜV NORD Systems GmbH & Co. KG.

Headquarters
TÜV NORD Systems GmbH & Co. KG

Große Bahnstrasse 31
22525 Hamburg
Phone: +49 40 8557-0
Fax: +49 40 8557-2295
info@tuev-nord.de
www.tuev-nord.de

TÜV NORD GROUP

Chairman of the Supervisory Board
Dr. Dirk Stenkamp

Registration Office
Amtsgericht Hamburg
HRA 102137
VAT No.: DE 243031938
Tax No.: 27/628/00031

General Partner
TÜV NORD Systems
Verwaltungsgesellschaft mbH, Hamburg

Registration Office
Amtsgericht Hamburg
HRB 88330

Director
Dr. Ralf Jung (CEO)
Silvio Konrad
Dr. Astrid Petersen
Ulf Theike

1 Introduction

The Pleated Combi Filter Element "Roger Dual Filter H12" of Stadler Form is tested according to DIN 71460-1:2006, Section 8.2 and the standards cited therein. The examined value is the initial fractional efficiency. Chapter 2 provides a general overview of the test object and test conditions.

The tests are carried out in the Business Segment Refrigeration & Air Quality, DMT GmbH & Co. KG, in Essen. The results of the tests are listed in Chapter 3.

2 Testing object and test conditions

2.1 Description of the test object

Figure 1 and Figure 2 show photographs of the tested Pleated Combi Filter Element.



Figure 1: Upstream side of the Pleated Combi Filter Element – "Roger Dual Filter H12"

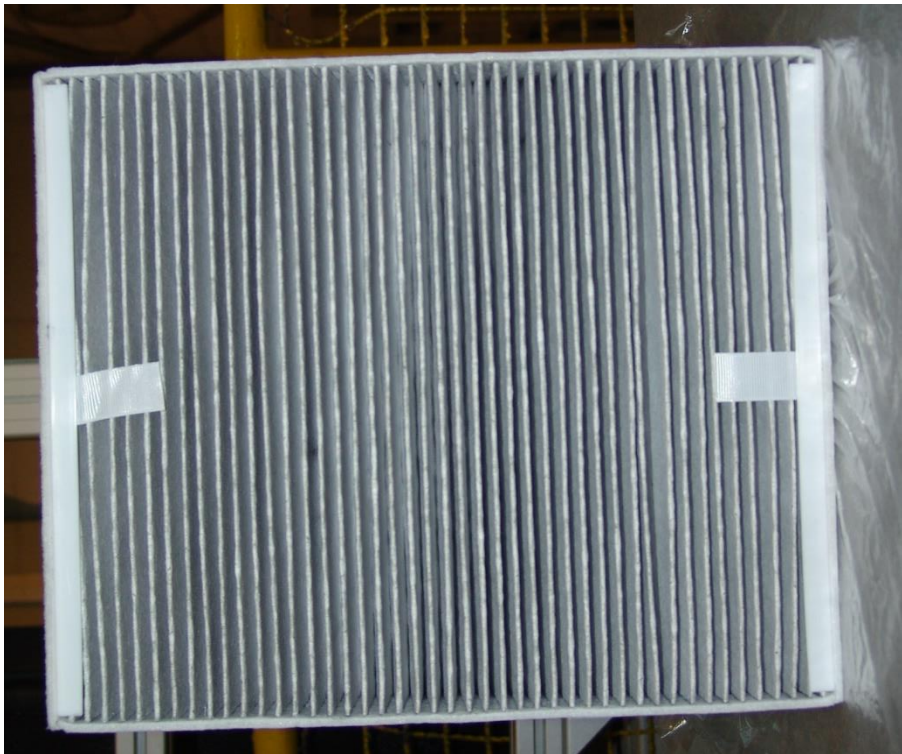


Figure 2: Downstream side of the Pleated Combi Filter Element – "Roger Dual Filter H12"

Table 1: Description of the testing object

Characteristic	Value
Designation	"Roger Dual Filter H12"
Type	Combi filter (HEPA and activated carbon filter)
Length	322 mm
Width	268 mm
Depth	45 mm
Filter area	Not indicated Lab-measurement: approx. 0.09 m ²
No. of pleats	42
Filter material	Not indicated
Serial-No.	Not indicated
Drawing-No.	Not indicated

Note: All technical data and general information according to client's information.

2.2 Test conditions and procedure

Boundary condition of the test:

- Test volume flow: 290 m³/h
- Dust concentration: 75 ± 5 % mg/m³
- Test dust: A2 fine (ISO 12103-1)
- Air temperature: 23 ± 2 °C
- Air humidity: 50 ± 3 %
- Drying for 24 h in a climate cabinet at 60 °C.
- Equilibration inside the test channel at rated volume flow for 15 min

The determination of the differential pressure loss curve and the dust holding capacity were not part of the order.

2.3 Measurement equipment

Measurement equipment installed for the test:

- Particle counter: "Welas 300" of Palas
- Particle disperser: "RBG 2000" of Palas
- Differential pressure: "ManoAir 500" of Schildknecht
- Rel. humidity/Temperature: "SD700" of Extech Instruments
- Dilution device: "VKL-10" of Palas
- Volume flow: "Inlet Nozzle" of Westenberg

3 Test results

Test conditions:

- Air temperature: 21 °C
- Relative air humidity: 48 %
- Air pressure (ambient): 1028 hPa
- Air volume flow: 290 m³/h
- Dust concentration: 75 ± 3,75 mg/m³
- Repeat measurements: 3
- Duration of measurement: 1 min each measurement
- Initial differential pressure: 79 Pa

Table 2: Fractional efficiency of the clean filter

X_m	Fractional efficiency	X_m	Fractional efficiency
µm	%	µm	%
0,255	100,00	2,212	100,00
0,295	99,07	2,555	100,00
0,341	99,53	2,950	100,00
0,393	100,00	3,407	100,00
0,454	100,00	3,934	100,00
0,525	100,00	4,543	100,00
0,606	100,00	5,247	100,00
0,700	100,00	6,059	100,00
0,808	100,00	6,996	100,00
0,933	100,00	8,079	100,00
1,077	100,00	9,330	100,00
1,244	99,05	10,774	100,00
1,437	100,00	12,442	100,00
1,659	100,00	14,367	100,00
1,916	100,00	16,591	100,00

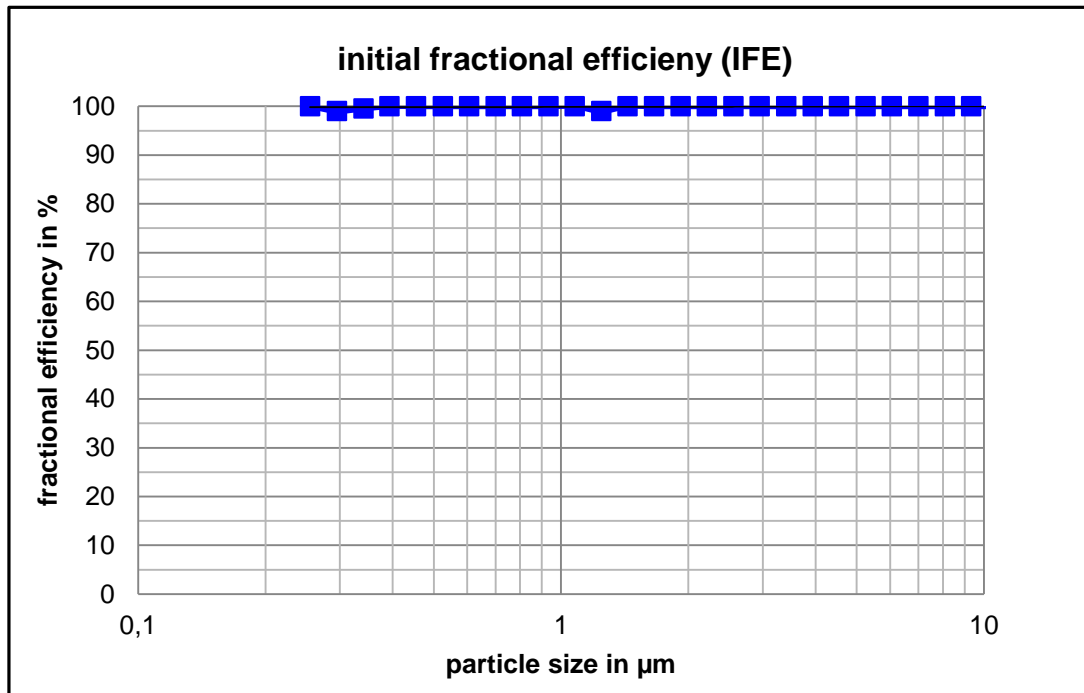


Figure 3: Fractional efficiency of the clean filter

Essen, 1 December 2020

Dipl.-Ing. Vera Gräff

Project manager Indoor Air Hygiene Group

Customer Name Stadler Form Aktiengesellschaft

Customer Address Chamerstrasse, 174,
6300 Zug,
Switzerland.

Contact Thomas Becker

Test Requested To assess the impact of the
Influenza A (H1N1) virus in a

Sample Descripti Roger Little

Number of Sampl 1

Date of Receipt 17 September 2020

ASC Code ASC004019

Report Number ASCR092436

Report Date 07 December 2020

Contents


1. Purpose.....	3.....
2. Test Item Description.....	3.....
3. Materials and Methods.....	3.....
4. Protocol.....	4.....
5. Results and Discuss.....	6.....
6. Conclusion.....	9.....
7. References.....	9.....

1. Purpose

This report outlines the results of a study to determine the effectiveness of a Rogelritt air purifier in removing airborne Influenza A (H1N1) from a 285 L chamber.

2. Test Item Description

The Rogelritt air purifier, a Syadler F...
to airmile health group was received 10th
September (Figure 2.1).

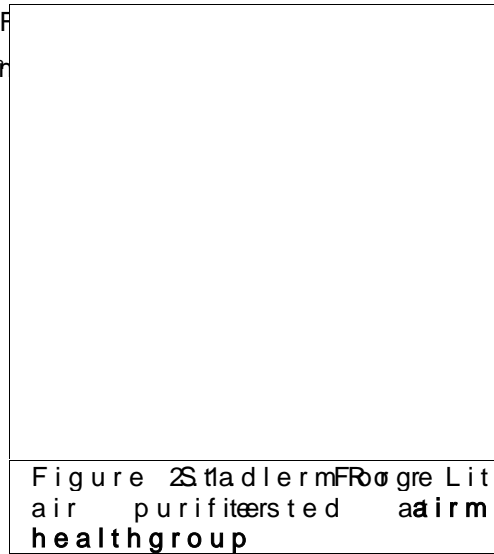

3. Materials and Methods

3.1. Materials

- Influenza A (H1N1) 34
- Influenza A Virus Capture ELISA
- Influenza A Virus Transport Medium

3.2. Influenza A

Influenza virus infection is one of the most common infectious diseases and can occur in people of any age. Influenza A viruses are transmitted by direct contact, indirect contact, respiratory droplets and aerosols (droplets and aerosols). Influenza viruses belong to the Orthomyxoviridae family and are divided into three types: A, B, and C. Influenza types A and B are responsible for epidemics of respiratory illness associated with increased rates of hospitalization and death. During the 1960s, only influenza A subtypes that circulated extensively in humans were (H1N1); (H2N2) Asian Flu; and (H3N2) Hong Kong Flu. A new strain emerged in 2009 called Swine Flu as it originated in swine and spread to humans.

recently in 2013, a new strain of Avian Influenza A, H7N9 has infected humans. It is believed to be from exposure to infected poultry.

All known subtypes of influenza A viruses have been isolated from birds and a range of mammalian species. As with humans, the number of influenza viruses isolated from other mammalian species is limited. Influenza A viruses do not exclusively infect humans.

In this study, influenza type A virus has been used for the testing of air purifiers.

4. Protocol

4.1. Test Conditions

Testing of standard room air purifiers was conducted in an environmental test chamber. The chamber was pre-conditioned to 20 ± 2 °C and 50 ± 5% relative humidity before commencement of the tests. The chamber was sterilized by operating a UV germicidal lamp, ceiling of the chamber, for at least 30 minutes. Air was extracted from the test chamber through HEPA filters. The filtered air was re-supplied to the chamber via a high efficiency HEPA filter. The chamber was washed with 5% Virkon disinfectant solution.

4.2. Air Purifier Control and Test Runs

Six decay tests were performed in the environmental chamber consisting of:

- Three active control runs with air purifier
- Three active test runs with room air purifier at maximum airflow

For the active test runs the purifier was placed on the floor in the centre of the chamber. For the active control runs the purifier was placed in the chamber in the absence of the virus. Three replicates per sample timepoint were collected during the test runs.

In both the active and control runs, the virus was aerosolized in the chamber for 20 minutes. The amount of virus aerosolized was dependent on the virus stock used, however, approximately 10⁷ virus particles were introduced to the test chamber for each run. The viral aerosol was mixed in the chamber by a mechanical fan, operating at low speed for the duration of the test runs.

4.3. Sampling Time Points

Three SK BioSampler collected air samples at 1 m height for 108 minutes at 1 l/min at the following time points

- -10 to 0 min (A S1)
- 0.5 to 51 min (A S2)
- 2.0 to 30 min (A S3)
- 50 to 60 min (A S4)



For the test runs the sampler was operated remotely and remained operating for the duration of the test. At the end of the test, the samples removed from the sampler and transferred to sterile 40 ml tubes that were placed on ice and then stored at -20°C until analysis.

4.4. Sample Analysis

Influenza A quantification was performed using an ELISA (Enzygnost) immunosorbent assay based assay technique that uses antibodies specificity to detect and quantify substances, such as peptides and nucleoprotein I (NP1) reportable. The NPIA is used to refer to the virus quantified by the ELISA. The concentration of Inf A in the sample reported in this report is in pfu/ml of sampled air. Virus reduction percentage was calculated according to the formula below:

5. Results and Discussion

The recovery concentrations of Inf A in control runs and at the test runs are reported in Tables 5.1 and 5.2. Each result is the average of three samples taken at the indicated time. The Inf A concentration was determined by ELISA and converted into µg/m³ or µg/m³ per cubic metre of air sampled by the BioSampler.

Timepoint	Control 1	Control 2	Control 3	Average = 3
-10 0	2729.1	3447.4	3900.1	3358.9
5 15	2099.3	1973.9	2770.5	2281.2
20 30	1546.7	1511.5	2294.5	1784.2
50 60	874.9	773.3	1386.7	1011.6

Timepoint	Test 1	Test 2	Test 3	Average = 3
-10 0	3800.9	3594.9	3898.4	3764.7
5 15	188.4	147.5	231.5	189.1
20 30	67.5	164.0	85.1	105.5
50 60	<LOD	<LOD	<LOD	<LOD

<LOD: Less than the limit of detection

Figures 5.1 and 5.2 show the trend of Inf A levels over time in the test runs respectively. The rapid reduction in Inf A concentration observed in the test runs cannot be attributed to natural decay due to forces exerted on the virus particles. In the three test runs, at 50 and 60 minutes of the air sample, the Influenza A concentration had dropped below the detection limit of the assay. The virus concentration difference among the sampling time points can be ascribed to the virus stock used to perform the unsampling process itself. As reported by Fabian et al. (2003), laboratory SKOBE Samplers present the most efficient airborne virus particle collection tool in terms of virus infectivity preservation and collection efficiency. The BioSampler recovery efficiency is about 79% for particles sized > 0.3 µm, which is the collected concentrations of Inf A particles sized ~ 0.1 µm.

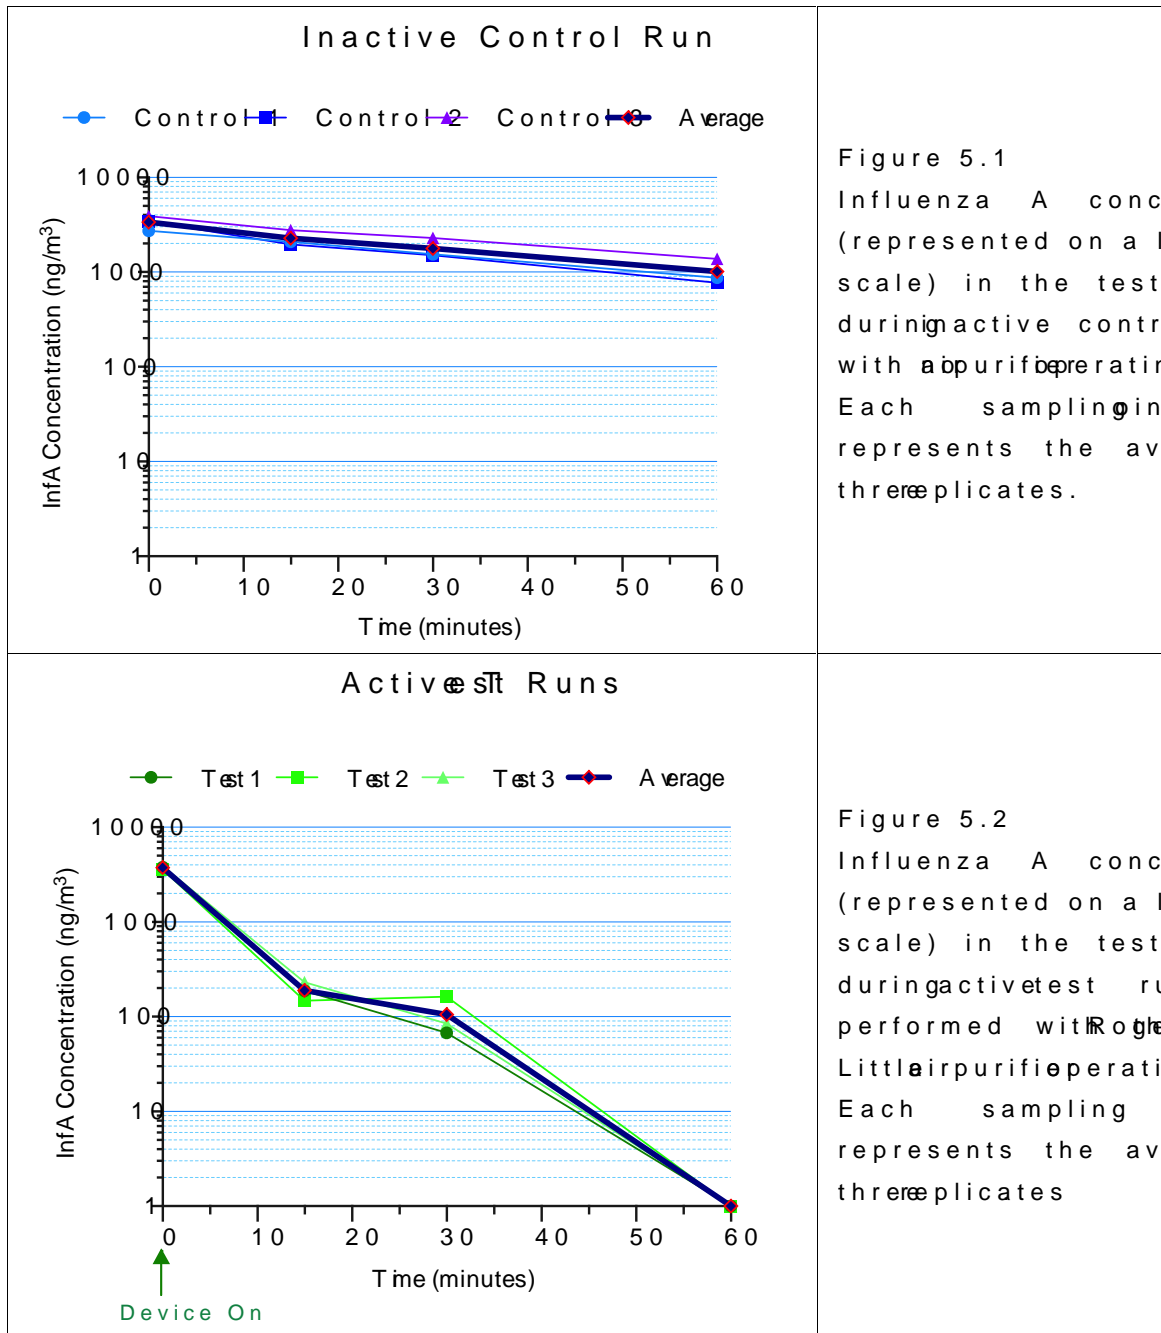


Figure 5.1
Influenza A concentration (represented on a log scale) in the test chamber during inactive control run performed with a Rogel Little air purifier. Each sampling represents the average of three replicates.

Figure 5.2
Influenza A concentration (represented on a log scale) in the test chamber during active test run performed with a Rogel Little air purifier. Each sampling represents the average of three replicates.

The data presented show that in the 60 minutes of the Stadler Form LR1000 air purifier operating at the highest fan speed, the Influenza A concentration in the test chamber was reduced to less than the detection limit of the assay (1 ng/m³) of the airborne virus.

Figure 5.3 shows the percentage reduction in the Airborne Concentration (calculated in Section 4.4) during the control and test runs. Filtration efficiencies observed

during control runs. Statistical fluctuations appear to be normally distributed like the described in the several factors affect the results of the sampling process and the assay bring variability, and one must not forget that the virus, and the environment of human body is also an indoor space with certain physical characteristics, where physical forces such as inertia and diffusion are throughout the test duration (Hind 1999, U.S. EPA 2010, Lisak et al. 2000). may also adhere to chamber surfaces after contact into areas of the chamber with a lower or null concentration of virus, with a number of particles is collected by the SKC Biosampler. A 9.1% decrease in Inf A levels is observed in 60 minutes after the purification is turned on.

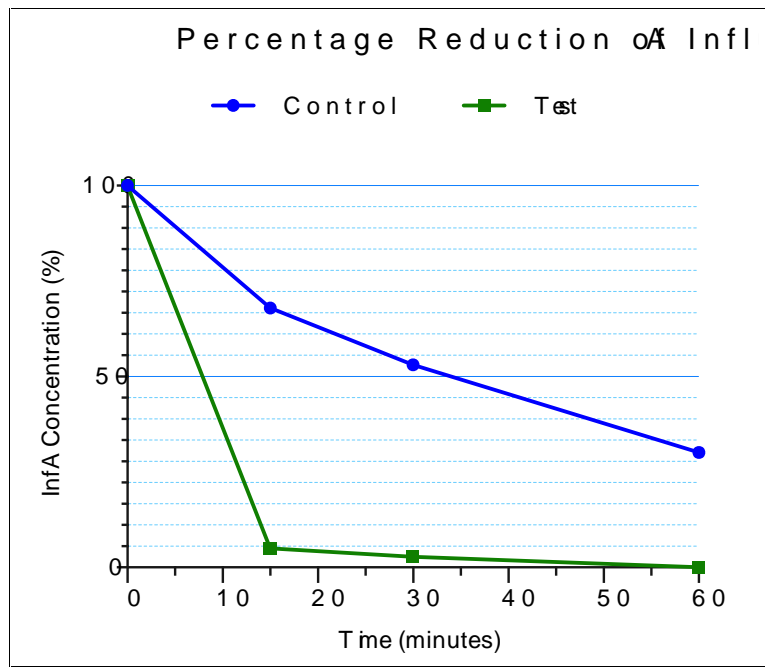


Figure 5.18. The average percent reduction of InfA and control runs (n=3)

6. Conclusion

The Stadler Form LR air purifier was demonstrated to be effective in reducing Influenza A aerosols in the test chamber by 99.9% or greater in 60 minutes of operation at the highest flow rate. These results indicate that in the presence of a unit the Influenza A concentration in the test chamber was reduced to below the detection limit of the assay performed to quantify the collected airborne

7. Reference

- Hinds (1999). Aerosol Technology. John Wiley & Sons, Weinheim / Brisbane / Singapore / Toronto.
- Fabian P., McDevitt J.J., Houseman E.A., Milton D.K. (2009). An optical method for detecting influenza virus and human rhinovirus from exhaled breath and the air in a room. *Journal of Aerosol Medicine and Pulmonary Drug Delivery*, 19(5): 433.
- EPA/600/R-127 (2010). Development of a Methodology to Detect Viable Aerosols in Personal Aerosol Sample.
- Lee I., Kim H., Lee D., Hwang G., Jung G., Lee M., Lim J. Lee B. (2007). Distribution and Genetic Characteristics of Aerosolized Influenza A H1N1 Virus in a Public Place. *Aerosol and Air Quality Research*, 11, 230

This report is provided on a confidential basis for the client's use only pursuant to the agreement between airmid healthgroup and its client. A right of action cannot be assigned. Healthgroup's responsibility under the report is limited to proven negligence and will in no case be more than the testing fees. The results shown on one sample(s) tested unless otherwise stated, under the conditions agreed upon. The client should understand all of the details of the engagement. Only the client may copy or make this report available to any third party, and then only in a form that does not include the name of airmid healthgroup limited name or any other materials, including any publicity or advertising activities relating to the tested product or service. Client consent is required for airmid healthgroup.

Report written by:

Report reviewed by:

Jake Behan, BSc.
Head of Operations

Vivienne Mahon, PhD
Chief Scientist/Qual

End of Report



Stadler Form
Chamerstrasse 174
6300 Zug

Burgdorf, 25.06.2020

Test order No. 2020-0883

Date of order: 15.06.2020
Responsible:
Pages: 3

Method:

JIS L 1902 Quantitative analysis for determination of the
bacteriostatic activity:

SANITIZED AG

A handwritten signature in blue ink, appearing to read "E. Rohrbach".

Erich Rohrbach
Head Microbiology

The findings are valid for the tested object(s) only. Filing record of report and documentation is 10 years.

Results

Description of sample

Sample number: **2020-0883-01** Received: 15.06.2020
Business: TEXTILE Type: QC
Identification: Sample 1
Main Component: 100% CO
Field of Application: Clean air device
Sanitized Products: Sanitized® T 11-15
Declared quantity: 2%

Pretreatment: 20x washings according to EN ISO 6330 (4M) 40°C

Test results of the SANITIZED-laboratory

Quantitative analysis for determination of the bacteriostatic activity:				
Method	Test point	Activity	Reduction in %	Evaluation
JIS L 1902	Staphylococcus aureus ATCC 6538	>5.30	>99.99	Good effect

Results

Description of sample

Sample number: **2020-0883-02** Received: 15.06.2020
Business: TEXTILE Type: QC
Identification: Sample 2
Main Component: 100% CO
Field of Application: Clean air device
Sanitized Products: Sanitized® T 11-15
Declared quantity: 3%

Pretreatment: 20x washings according to EN ISO 6330 (4M) 40°C

Test results of the SANITIZED-laboratory

Quantitative analysis for determination of the bacteriostatic activity:				
Method	Test point	Activity	Reduction in %	Evaluation
JIS L 1902	Staphylococcus aureus ATCC 6538	>5.30	>99.99	Good effect